


SI-1-4 BAND SW .a OFF  
 b 144~146  
 c 146~148

**FTV-250**  
**CIRCUIT DIAGRAM**



Modified to operate either FT-250 or FL-2100B  
 from FT-101E. Relay added in FT-250

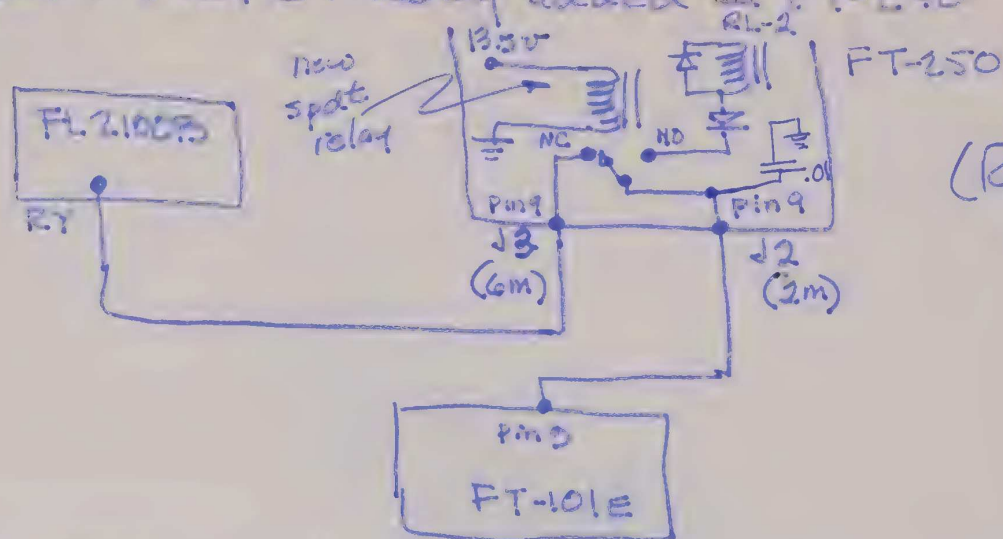

When FT-250 is off, no 13.5V is available in 250 so relay is not energized & NC contact connects RY of 2100B to FT-101E for HF operation. When FT-250 is switched to 144-148, 13.5V energizes relay & switches 101E to FT-250

11-88

CHANGED RCA PLUG TO SO-239 ON TRX OUT TO AVOID UMI  
 CABLES (J5)